


NOISE AND VIBRATION - Figure 3

Cosumnes Power Plant - Valve #190 Elk Grove Compressor Station - Noise Monitoring Location

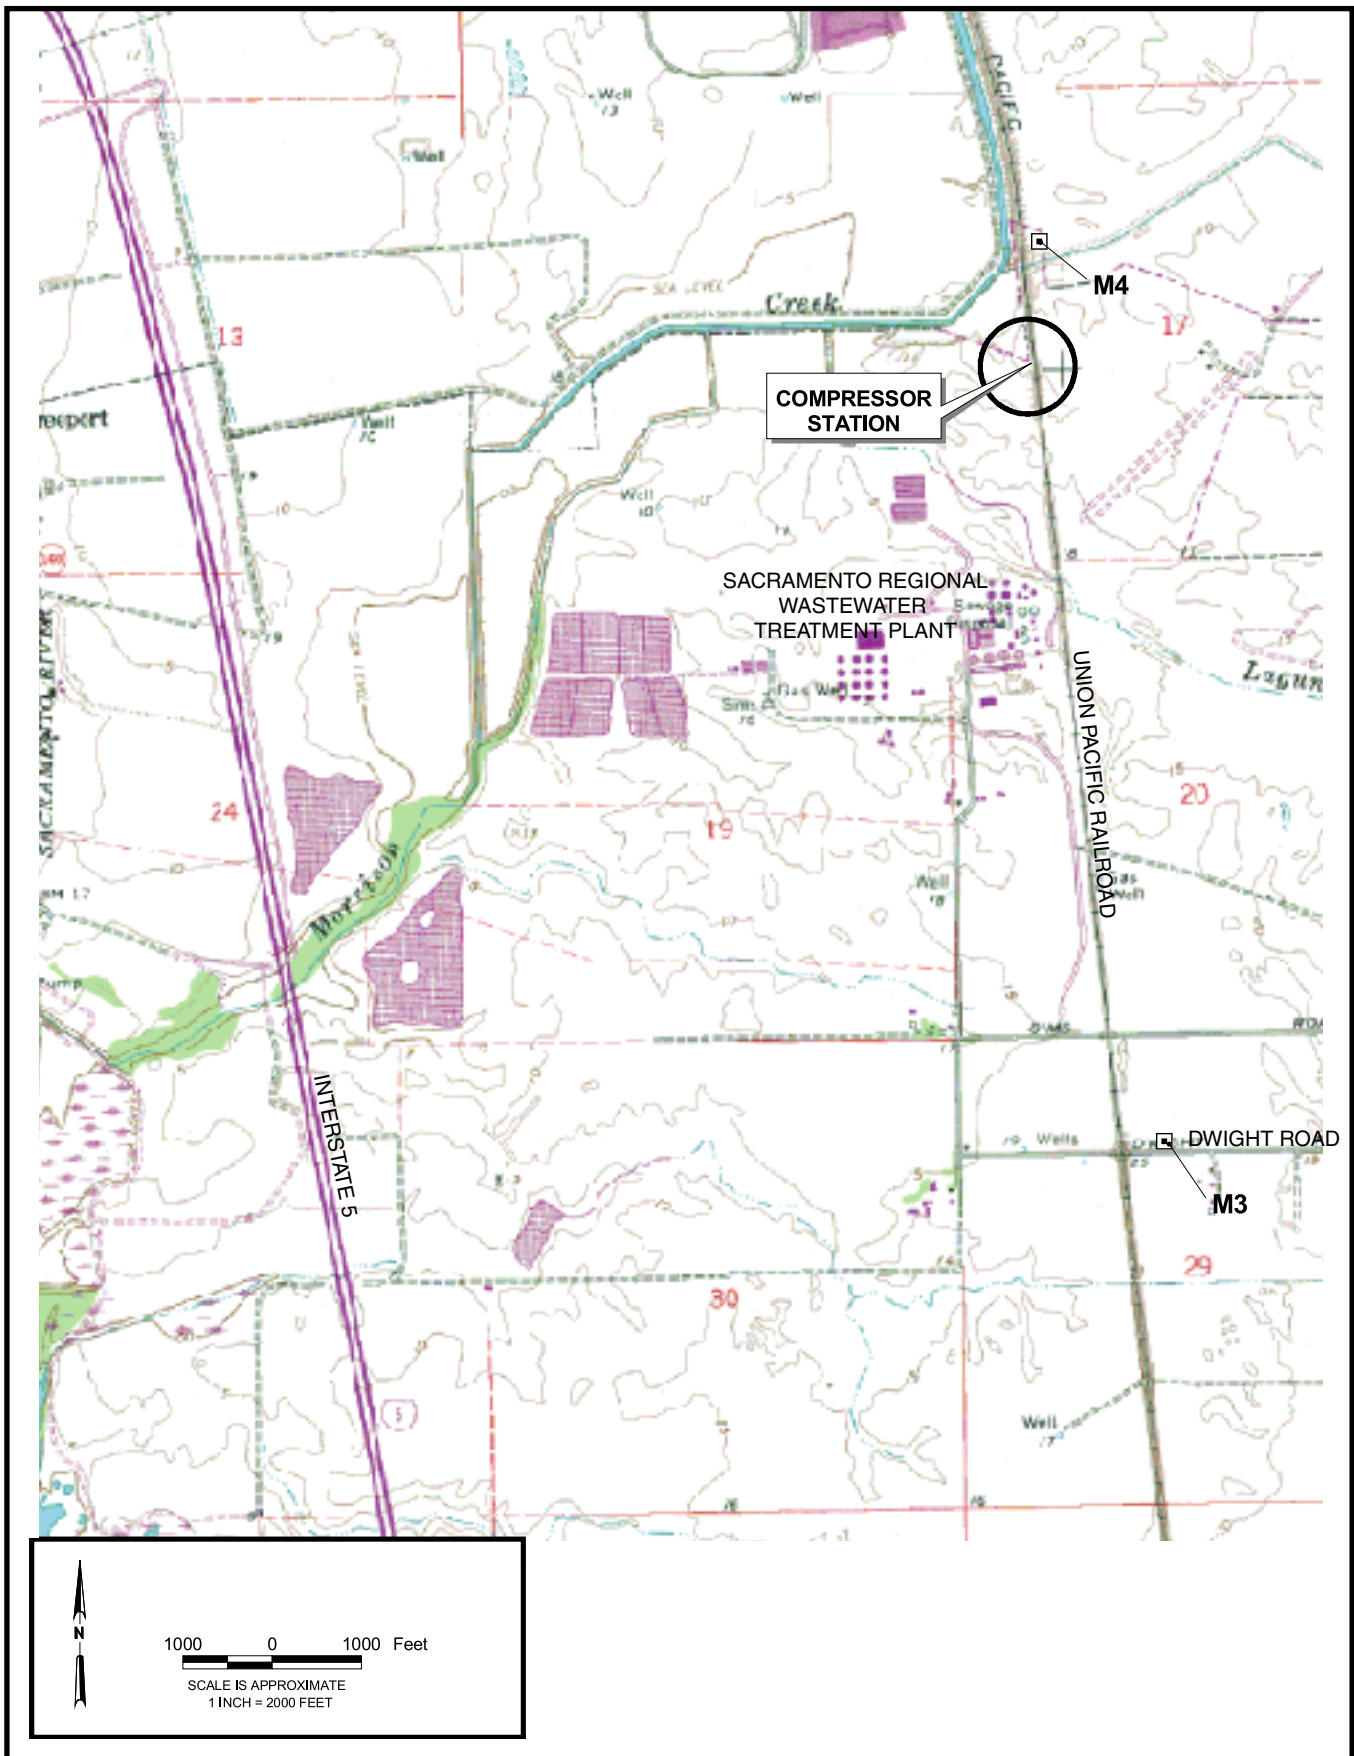

CALIFORNIA ENERGY COMMISSION, SYSTEMS ASSESSMENT & FACILITIES SITING DIVISION

SOURCE: SMUD 2002p, Figure 2.5-2